

## CUSTOMER REFERENCE

**MJS P7140 7mm 140 Density NORTHSTATE RECOIL 26 oz/ yd<sup>2</sup>****Sample description as provided by customer**

Order No. KKrebs

Mass/ unit area **26 oz/ yd<sup>2</sup>**Pile Fibre Content **100% SOLUTION DYED NYLON**Construction Details **Tufted** Secondary Backing **Synthetic**  
Style **Loop Pile**Colour **Brown/Gold**

Pile Height / mm

**TEST METHOD AS/ISO 9239.1 2003 Reaction To Fire Tests For Floorings Part 1 Determination of the Burning Behaviour Using a Radiant Heat Source. As required by specification C1.10a of the Building Code of Australia.**

The test values relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be the sole criterion for assessing the potential fire hazard of the product. Clause 9 of AS/ISO 9239 Part 1.

Conditioning as specified in BS EN 13238.2001

Sample submitted Date **May 2013**Test Date **29 May 2013****ASSEMBLY SYSTEM: OVER UNDERLAY MJS P7140 7mm 140 Density.****The UNDERLAY used was MJS P7140 7mm 140 Density.****Substrate: Non-Combustible****Substrate –6mm Fibre Reinforced Cement Board to simulate a Non-Combustible Flooring.**

The Holding Torque on Specimen Frame was 2Nm.

Initial Test	Specimen 1 Length Direction	Critical Radiant Flux <b>1.6 kW/ m<sup>2</sup></b>
	Specimen 1 Width Direction	Critical Radiant Flux <b>1.4 kW/ m<sup>2</sup></b>
	Full tests carried out in the	<b>Width</b> Direction

SPECIMEN	Width #1	Width #2	Width #3	Mean
Critical Radiant Flux (kW/ m <sup>2</sup> )	<b>1.4</b>	<b>1.7</b>	<b>1.4</b>	<b>1.5</b>
Smoke Development Rate (%min)	<b>353</b>	<b>301</b>	<b>329</b>	<b>323</b>

The values quoted below are as required by Specification C1.10a Fire Hazard Properties (Floors) of the Building Code of Australia. The Critical Radiant Flux quoted is the value at Flame-Out/ Extinguishment (BCA General Provisions A1.1).

**MEAN CRITICAL RADIANT FLUX 1.5 kW/ m<sup>2</sup>****MEAN SMOKE DEVELOPMENT RATE 323 percent-minutes**

OBSERVATIONS: The samples shrunk away from the heat source, ignited and burnt.

**PAGE 1 of 2**

This Page (1) has been designed to show the values required under Specification C1.10a Fire Hazard Properties (Floors) of the Building Code of Australia.


The values on Page 2 have no relevance to the Code.

1004 04 09

TIME FOR EACH SPECIMEN TO REACH EACH MARKER IN SECONDS

Specimen	50	60	110	160	210	260	310	360	410	460	510	560	610	660	710	760	810	860
1	154	156	196	225	263	281	294	316	348	441	482	707	1051	1481	1987	2295	/	
2	174	176	201	234	267	280	297	314	331	354	423	639	1140	1292	2196	/		
3	183	186	203	249	255	288	306	328	365	408	479	736	1096	1503	1885			

TESTS		BURNING CHARACTERISTICS		SMOKE PRODUCTION	
Specimen		Burn Length (mm) at Flame Out/ Extinguishment	Time To Burn Out (s)	Maximum Light Attenuation (%)	Smoke Development Rate (%.min)
Initial Test: Length		730	2,186	78	342
Specimen Tests: Width					
1		760	2,297	80	353
2		710	2,296	80	301
3		758	2,310	79	329
Mean		743	2,301	80	323

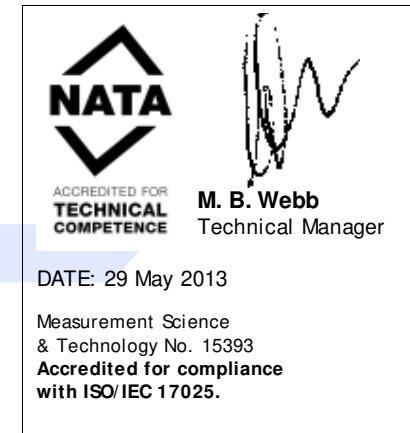

The laboratory does not allow the use of this page of the report without the use of page 1.

This page alone has no validity under Specification C1.10a Fire Hazard Properties (Floors) of the Building Code of Australia.

2004 04 09 17509 29 May 2013